





Oil/air cooler ELK

Temperature is one of the key parameters in oil-hydraulic systems. Oils change their viscosity with the temperature, resulting in different lubricating and adhesion properties.

A carefully selected temperature level can also significantly extend the life of the oils.

Die ELK series oil/air coolers stabilise the temperature reliably and efficiently, both in the return or bypass of the systems.

The ELK series is characterised by efficient cooling matrices made from high-strength aluminium as well as a simple and affordable design. They are equipped with energy-efficient fan motors.

Compact design

Bühler Technologies GmbH, Harkortstr. 29, D-40880 Ratingen Tel. +49 (0) 21 02 / 49 89-0, Fax: +49 (0) 21 02 / 49 89-20

E-Mail: fluidcontrol@buehler-technologies.com

Internet: www.buehler-technologies.com

Low noise emission

High cooling capacities

Rugged cooling matrix

Flexible use in the return or bypass



Planning information

Set-up

The cooler must be set up so as not to interfere with air supply and exhaust. The distance to air obstacles behind the cooler should be at least half the cooler height (Dimension B).

Ensure adequate ventilation. During set-up, avoid exiting hot air or noise emission causing problems.

If the ambient air is dirty, excess deposit on the cooling matrix must be expected. This will reduce the cooling capacity. In this case, particularly in the case of air loaded with oil mist, the air ducts must be cleaned regularly.

When set up outdoors, adequately protect the motor from the weather.

Ensure easy access for inspection and maintenance.

Mount

The coolers are secured to the mounting rails with four screws. Be sure the support structure is sized adequately. Install in any position.

Connecting the oil circuit

The connection between the system and the cooling matrix should be connected stress and vibration free, which can be achieved by using conduit.

Follow the pertinent safety regulations to prevent environmental damage due to possible oil leaks (e.g. collection pans).

Technical data

Technical Data

Materials/surface protection					
Cooling matrix:	Aluminium, powder-coated				
Fan hub:	Aluminium, bare				
Fan blades:	Glass-reinforced polypropylene (PPG), bare				
Ventilation box, guard and motor brackets:	Steel, galvanised, powder-coated				
Screw connections:	V2A stainless steel				
Hydraulic screw fittings:	Steel, zinc-nickel coated				
Colour:	Steel parts: RAL 9005, jet black				
	Motor: RAL9005 jet black or RAL7031 blue grey				
	(special colours on request)				
Surface protection:	Steel parts: ISO 12944, C3 medium				
	Motor: ISO 12944, C2 medium				
	(higher on request)				
Operating fluids:	Mineral oils according to DIN 51524				
	Gear lubricant according to DIN 51517-3				
	Oil/water emulsions HFA and HFB according to CETOP RP 77 H				
	Water glycol HFC according to CETOP RF 77 H				
	Phosphoric ester HFD-R according to CETOP RP 77 H				
permissible operating pressure	241				
static	max. 21 bar				
dynamic	15 bar (at 2 M load cycle, 3 Hz)				
Operating oil temperature:	max. 80 °C (higher upon request)				
Ambient temperature:	-20 °C to +40 °C (different ambient temperatures on request)				
max. set-up altitude:	1000 m (higher on request)				
Electric motors (others available upon request)					
Voltage/frequency:	230/400 V 50 Hz				
	265/460V 60Hz				
	(special voltages/motor approvals on request)				
Thermal stability:	Class of insulation F,				
	utilisation per class B				
	(higher on request)				
IP rating:	IP55 (higher on request)				
The motors comply with standards					
IEC 60034, IEC 60072, IEC 60085, EU 2019/1781					

Basic data

Item no.	Cooler model	Power output Number of contacts Rated current		Weight (kg)	Volume (L)	Sound pressure level db(A)*	
		400 V 50 Hz	460 V 60 Hz	50/60 Hz	50/60 Hz	50 Hz	60 Hz
35ELK10040	ELK100 -50/60Hz	0.09 kW/4-poles/0.31 A	0.1 kW/4-poles/0.3 A	17	1.7	66	70
35ELK20040	ELK200 -50/60Hz	0.12 kW/4-poles/0.37 A	0.14 kW/4-poles/0.37 A	21	1.7	67	71
35ELK30040	ELK300 -50/60Hz	0.25 kW/4-poles/0.66 A	0.29 kW/4-poles/0.67 A	28	2.2	70	74
35ELK40040	ELK400 -50/60Hz	0.37 kW/4-poles/0.92 A	0.43 kW/4-poles/0.91 A	32	3.2	73	77
35ELK50040	ELK500 -50/60Hz	0.75 kW/4-poles/1.75 A	0.86 kW/4-poles/1.68 A	44	3.7	77	81
35ELK60041	ELK600 -50Hz	1.1 kW/4-poles/2.5 A	-	F.4	4.2	80	-
35ELK60042	ELK600 -60Hz	-	1.3 kW/4-poles/2.5 A	54	4.3	-	83

Calculation example and nomenclature

Determination

An oil/air cooler is determined in two steps:

- 1. Determining or selecting the cooler size
- 2. Determining the actual pressure loss

 $\begin{aligned} \textbf{t}_{\text{\"{O}E}} \left[^{\circ}\text{C} \right] & \text{Inlet oil temperature} \\ \textbf{t}_{\text{LE}} \left[^{\circ}\text{C} \right] & \text{Inlet air temperature} \end{aligned}$

ETD [K] Temperature differential: ETD = $\mathbf{t}_{\text{OE}} - \mathbf{t}_{\text{LE}}$

 $P_{\text{spez}}[kW / K]$ specific cooling performance (see performance curves): $P_{\text{spez}} = P / ETD$

P [kW] Cooling performance in kW

Q[l/min] Oil flow rate

C_{öl}[kJ/kgK] Specific heat capacity of the oil (approx. 2.0 kJ / kgK)

 ς [kg/dm³] Gravity of oil \approx 0.9 kg/dm³

Calculation example

Assumptions:

Tank capacity (V) approx. 200 L Start up temperature of oil (T_1) 15 °C (\approx 288 K)

Oil heats up in approx.

t = 25 min. (1500 s) to (T_2) 45 °C (\approx 318 K)

Required oil temperature (\mathbf{t}_{OE}) 60 °C Inlet air temperature (\mathbf{t}_{IE}) 30 °C

Calculation

1. Calculating P from the tank warming

$$P = \frac{V \cdot \varsigma \cdot c_{OiI} (T_2 - T_1)}{t} = \frac{200 \text{ I} \cdot 0.9 \frac{\text{kg}}{\text{I}} \cdot 2 \frac{\text{kJ}}{\text{kg} \cdot \text{K}} \cdot (318 \text{ K} - 288 \text{ K})}{1500 \text{ s}} = 7.2 \text{ kW}$$

- 2. ETD = $t_{\ddot{O}E}$ t_{LE} = 60 °C 30 °C = 30 K
- 3. Determining the cooler size: $P_{spec} = P / ETD = 7.2 \text{ kW} / 30 \text{ K} = 0.24 \text{ kW/K}$
- 4. In the graph, select a cooler at 80 L/min with P_{spec} 0.24 kW/K. \rightarrow ELK300

Performance curves

Tolerance: ±5%

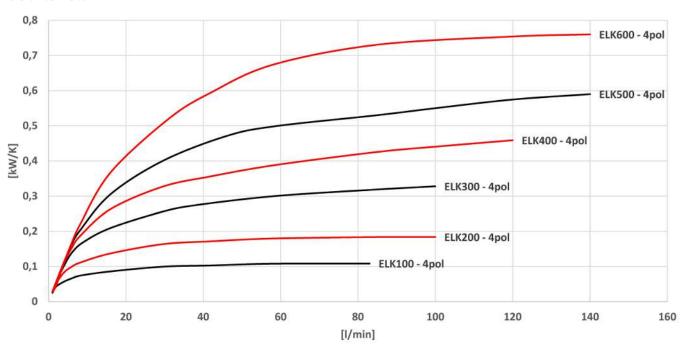


Fig. 1: Specific cooling capacity

Pressure loss curves at medium viscosity of 30 cSt

Tolerance: ± 5 %

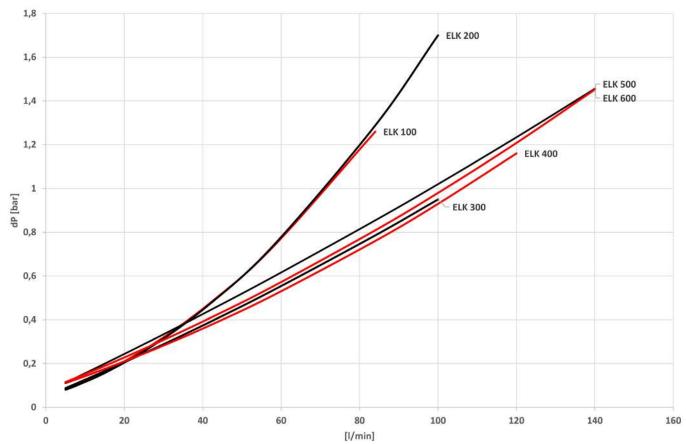


Fig. 2: Pressure loss

Note: When installed outdoors or using higher viscosities, an additional bypass valve may be required. These are not available for the ELK series. In this case, use our BLK series or an external bypass valve.

Temperature/viscosity table

Type of oil	at 50 °C	at 60 °C	at 70 °C
VG 16	9.4	5.6	3.3 cSt
VG 22	15	11	8 cSt
VG 32	21	15	11 cSt
VG 46	29	20	14 cSt
VG 68	43	29	20 cSt
VG 120	68	44	31 cSt
VG 220	126	77	51 cSt
VG 320	180	108	69 cSt

Correction k(visc)

Viscosity (cSt)	K(visc)			
10	0.8			
30	1			
50	1.1			
80	1.3			
100	1.4			
150	1.8			

Determining the actual pressure loss

- 1. Determine Δp from the pressure loss graph (Fig. 2) for oil flow rate L/min and the selected cooler size.
- 2. Determine the viscosity from the type of oil and temperature.
- 3. Determine the correction factor k(visc) and multiply by Δp from calculation step 1.

Model key

ELK 300-4-50/60Hz-xxx




ELK 300-4-50/60Hz-T50

To also have a thermal contact, the specification will be added to the type designation:

Temperature switch T50, T60 Temperature in °C, specification see T70, T80 separate data sheet


Dimensions

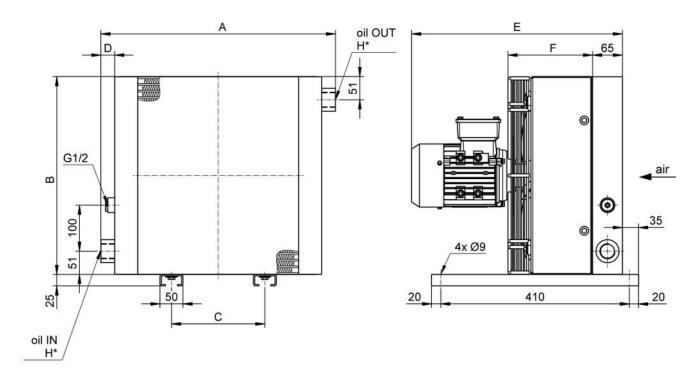


Type	Α	В	C	D	E	F	G	Н
ELK100	360	290	203	25	390	151	170	2x G3/4"
ELK200	425	355	203	25	402	144	202	2x G3/4"
ELK300	510	430	203	30	458	184	240	2x G1"
ELK400	570	491	203	30	476	202	270	2x G1"
ELK500	630	551	356	30	526	213	300	2x G1"
ELK600	690	611	356	30	606	245	330	2x G1"

Functional diagram

Standard ELK version





Direction of flow left to right or vice versa.

With temperature switch attached

